



FINDING COTTON FARMS MHP PUBLIC WATER SYSTEM ON NEW HAMPSHIRE'S DEPARTMENT OF ENVIRONMENTAL SERVICES (NHDES) WEBSITE:

1.) Go to <http://www4.des.state.nh.us/DESOnestop/BasicSearch.aspx>

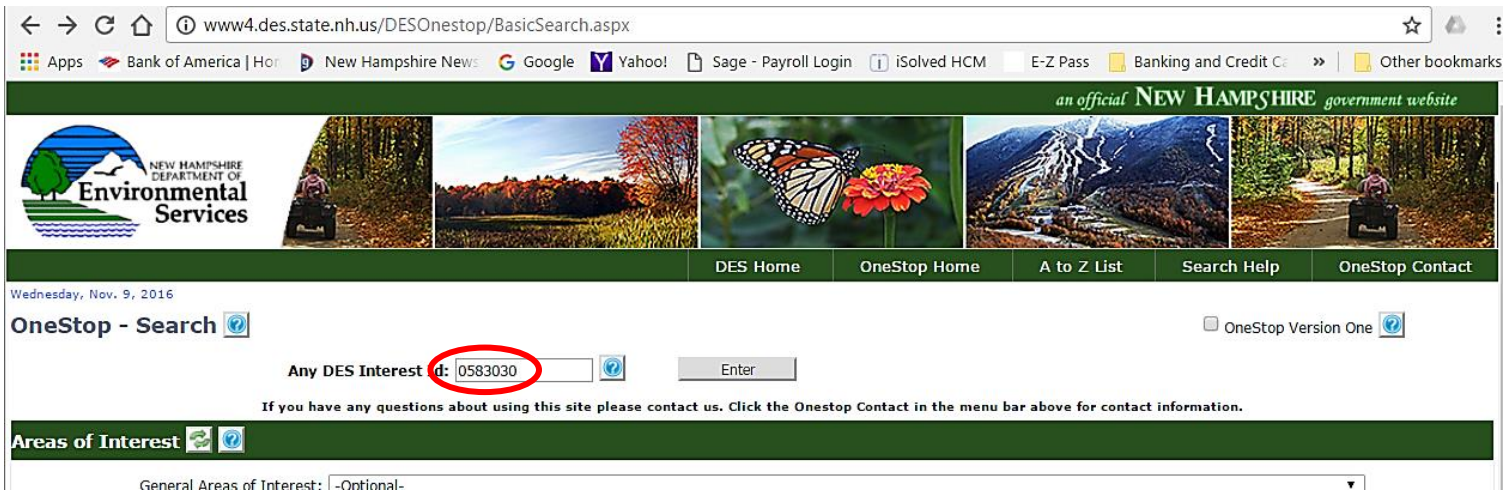


2.) Add Cotton Farms' Public Water System's ID, 0583030 in the "OneStop – Search" section and click "Enter".

This will bring you to here:

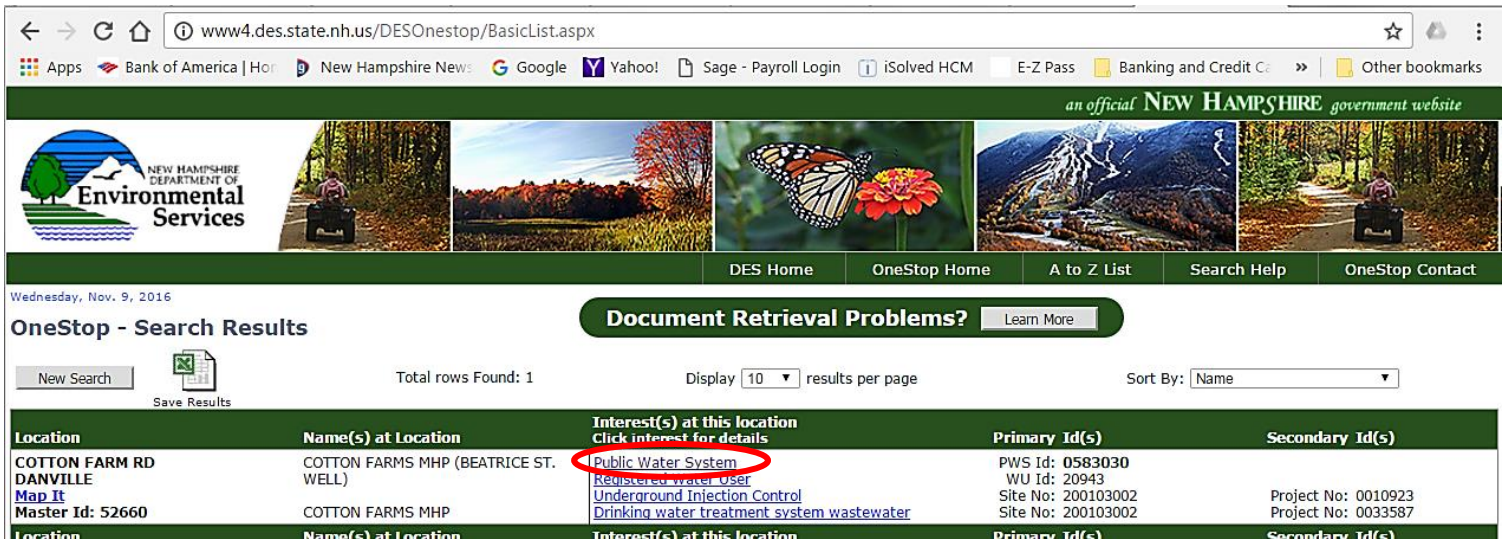

3.) Select "Public Water System" from the "OneStop – Search Results" section.

This will bring you to here:

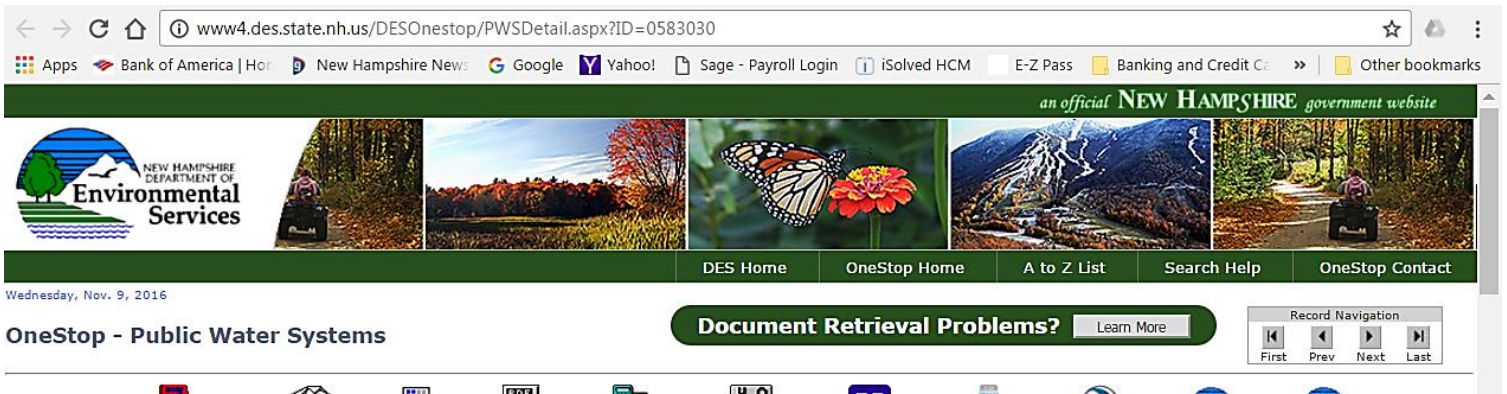

If you have any questions about or corrections to the information below, please contact us. Click the Program Contact button above for contact information.

PWS Id:

System Type:

System Name and Address:

System Category:

System Status:

Population Served:

Statup Date:

Service Connections:

Permits to Operate

Total = 11

Sort By:

Row	Year	Effective Date	Expiration Date	Issued Date	Permit	Application
1	2017	07/01/2016	06/30/2017	03/25/2016		
2	2016	07/01/2015	06/30/2016	05/11/2015		
3	2015	07/01/2014	06/30/2015	05/19/2014		
4	2014	07/01/2013	06/30/2014	04/30/2013		
5	2013	07/01/2012	06/30/2013	06/22/2012		
6	2012	07/01/2011	06/30/2012	04/27/2011		
7	2011	07/01/2010	06/30/2011	06/01/2010		
8	2010	07/01/2009	06/30/2010	06/09/2009		
9	2009	07/01/2008	06/30/2009	06/12/2008		
10	2008	07/01/2007	06/30/2008	06/05/2007		

[▲ TOP](#)

PWS Contacts

Total = 3

Row	Type	Name and Address	Phone	Primary Contact
1	OWNER	COTTON FARMS MHP LLC KENNETH BURNHAM STE 202 1080 PITTSFORD VICTOR RD PITTSFORD NY 14534	585-381-0570	NO
2	PRIMARY OPERATOR	HAMPSTEAD AREA WATER CO INC RICHARD BIBEAU 54 SAWYER AVE ATKINSON NH 03811	603-362-5333	NO
3	OWNER'S REPRESENTATIVE	COTTON FARMS MHP LLC CHARLIE LUCAS PO BOX 748 EAST HAMPSTEAD NH 03826	603-382-8203	YES

[▲ TOP](#)

Lead and Copper 90th Percentile

Total = 22

Sort By:

Row	Compliance Begin Date	Frequency	Monitoring Round	Lead 90 th Percentile	Copper 90 th Percentile	Calculated Date
1	01/01/2016	Semi-Annual	1	0.003	0.552	06/17/2016
2	01/01/2015	Semi-Annual	2	0.044	0.475	04/09/2015
3	07/01/2014	Semi-Annual	1	0.006	0.599	12/31/2014
4	01/01/2012	Annual	4	0	0.707	12/05/2012
5	01/01/2011	Annual	3	0	1.322	12/09/2011
6	01/01/2010	Semi-Annual	2	0.005	0.672	01/21/2010
7	07/01/2009	Semi-Annual	1	0.005	0.579	11/04/2009
8	01/01/2009	Semi-Annual	1	0.005	2.3	07/13/2009
9	01/01/2008	Semi-Annual	1	0.005	2.06	06/13/2008
10	07/01/2007	Semi-Annual	1	0.005	1.02	09/05/2007

[▲ TOP](#)

Samples

Total = 390

Note: Only samples processed by laboratories that report samples electronically are shown here.

Sort By: Collected Date

1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 ... >>

Row	Collected Date	Sampling Location	Sample Number	Sample Type	Laboratory
1	10/25/2016	004-52 COTTON FARM RD	3610-2670-2	LEAD AND COPPER RULE	NELSON ANALYTICAL LLC
2	10/25/2016	011-8 SUSAN ST	3610-2670-7	LEAD AND COPPER RULE	NELSON ANALYTICAL LLC
3	10/24/2016	002-11 CHRISTIAN ST	3610-2670-1	LEAD AND COPPER RULE	NELSON ANALYTICAL LLC
4	10/24/2016	014-29 BEATRICE ST	3610-2670-10	LEAD AND COPPER RULE	NELSON ANALYTICAL LLC
5	10/24/2016	015-5 LINDA ST	3610-2670-11	LEAD AND COPPER RULE	NELSON ANALYTICAL LLC
6	10/24/2016	016-5 BEATRICE ST	3610-2670-12	LEAD AND COPPER RULE	NELSON ANALYTICAL LLC
7	10/24/2016	018-52 JUDITH	3610-2670-13	LEAD AND COPPER RULE	NELSON ANALYTICAL LLC
8	10/24/2016	020-45C BEATRICE ST	3610-2670-14	LEAD AND COPPER RULE	NELSON ANALYTICAL LLC
9	10/24/2016	021-27 BEATRICE ST	3610-2670-15	LEAD AND COPPER RULE	NELSON ANALYTICAL LLC
10	10/24/2016	006-16 TIMOTHY ST	3610-2670-3	LEAD AND COPPER RULE	NELSON ANALYTICAL LLC

1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 ... >>

▲ TOP

Violations

Total = 8

Sort By: Begin Date

Row	Violation Description	Contaminant or Rule	Begin Date	Returned to Compliance	Regulator
1	DBP M/R	CHLORINE	07/01/2016		FEDERAL
2	GWR-TM MONITORING/ REPORTING VIO	ESCHERICHIA COLI (E. COLI)	11/20/2013	12/16/2013	FEDERAL
3	FAILURE TO CORRECT SIG DEF	GROUND WATER RULE	09/15/2013	08/08/2014	FEDERAL
4	PUBLIC NOTICE VIOLATION FOR NPDWR VIOS	PUBLIC NOTICE RULE	02/26/2013	03/22/2013	FEDERAL
5	FAILURE TO CORRECT SIG DEF	GROUND WATER RULE	12/21/2012	03/15/2013	FEDERAL

which is where you can find water sample test results and view them by clicking on the "Sample Number".